
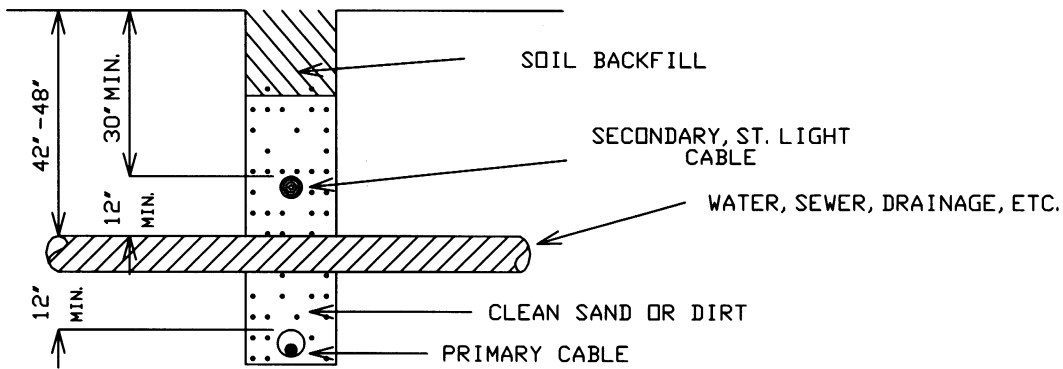
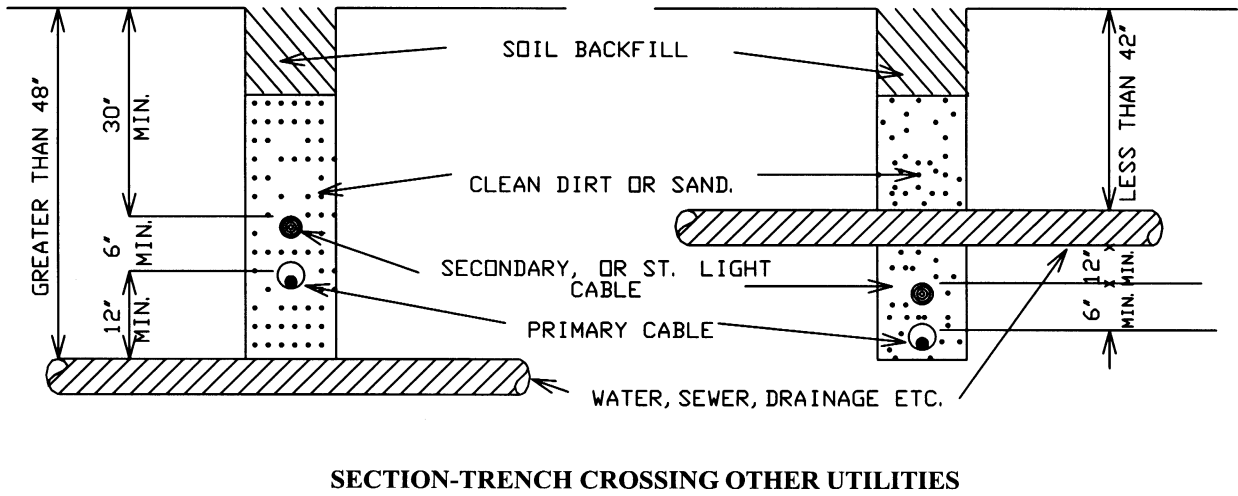


REV. #4 CHGD. CABLE DEPTH TO 36" MIN=PRI., 30" MIN=SEC. 12-9-98 GH
 REV. #3 CHGD. CABLE DEPTH TO 42" MIN=PRI., 36" MIN=SEC. 6-8-92 -MEH

APP. GEC DATE 10-15-85 APP. CLR DATE 10-15-85 APP. DATE

UNDERGROUND DISTRIBUTION TRENCHING
 DETAIL NON-JOINT USE

BY MEH
 DATE 7-22-85
 REV. 4 SHEET 1 OF 1
 T-2

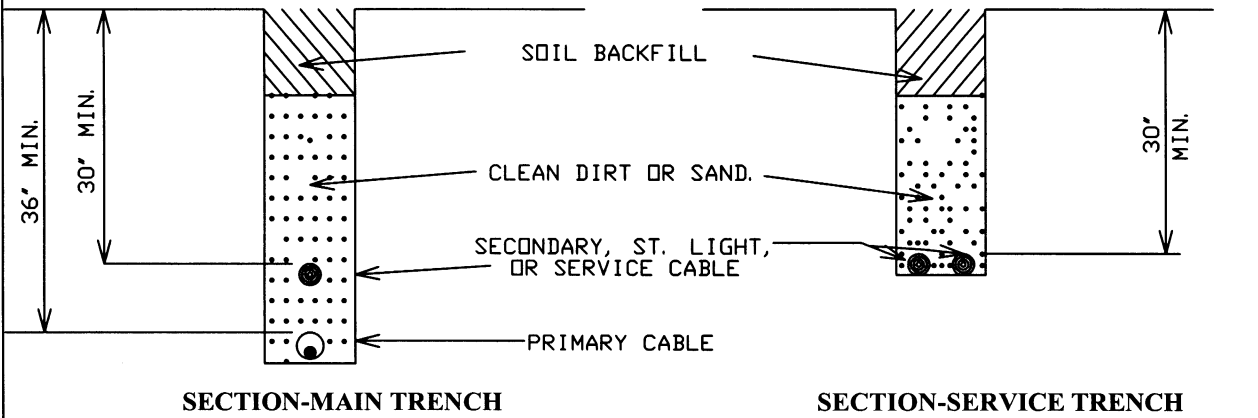

DISTRIBUTION CONSTRUCTION STANDARD
SOUTH CAROLINA ELECTRIC & GAS CO.

UNDERGROUND DISTRIBUTION PRIMARY AND SECONDARY CABLE DEPTHS

BY BH

DATE 7-22-85

T-3

REV. 2

SHEET 1 OF 1

REV. #2 CHANGED CABLE DEPTHS 04-17-00 -LEK-
REV. #1 CHANGED CABLE DEPTHS 9-8-95 -MEH-


DATE

DATE 10-15-85, APP.

APP. GCC

DATE 10-15-85, APP. CLR

DATE 10-15-85, APP. CLR

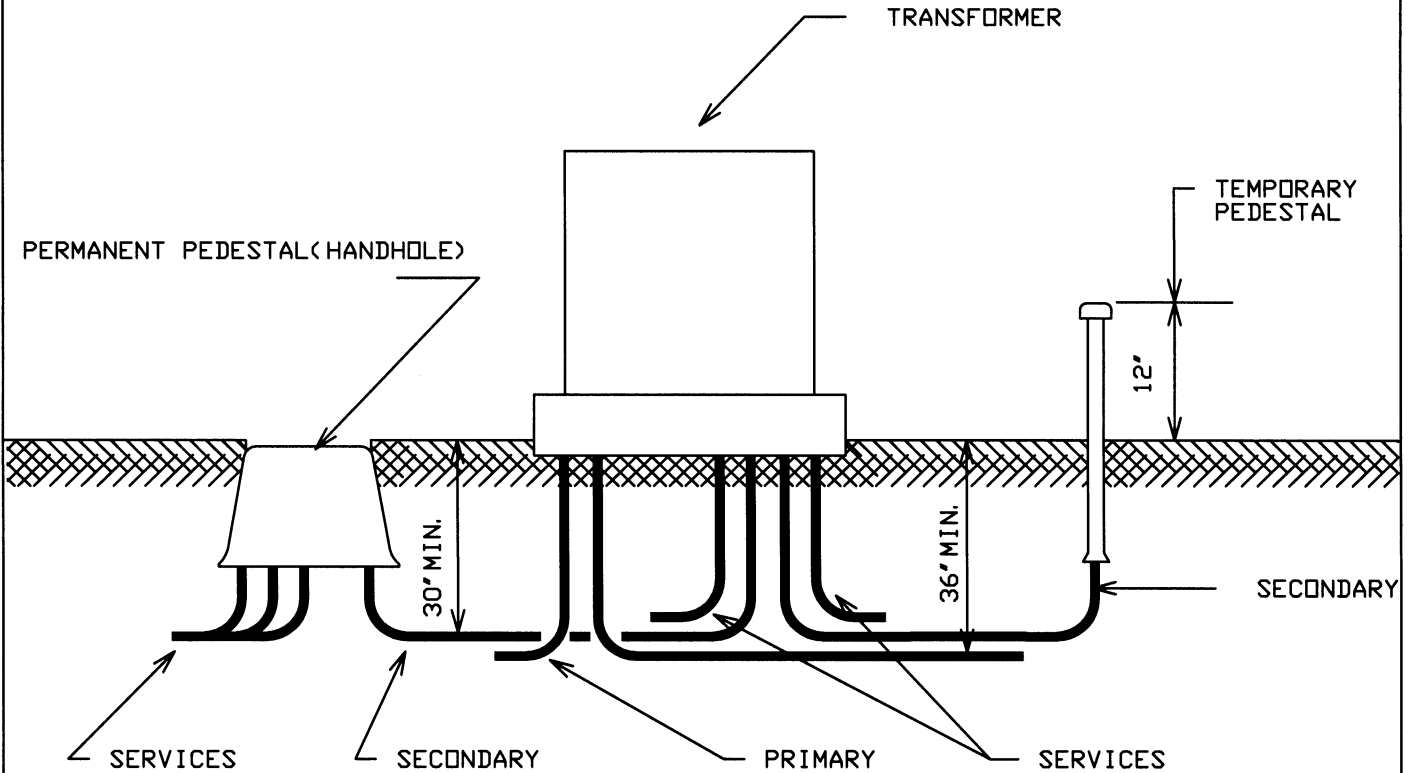

NOTE:

1. 3' FLEXIBLE CONDUIT SHOULD BE USED AT THE TRANSFORMER FOR SERVICES WHICH ARE TO BE INSTALLED AT A LATER DATE. SEE DWG. TR-2, SHT. 1 OF 1.

**DISTRIBUTION CONSTRUCTION STANDARD
SOUTH CAROLINA ELECTRIC & GAS CO.**