
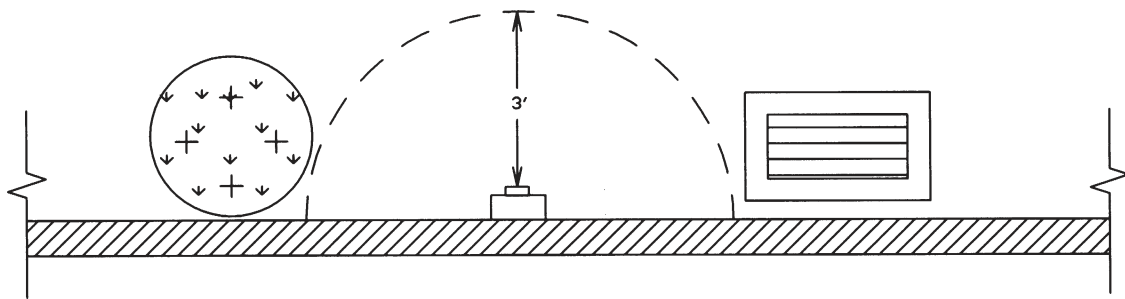


PREFERRED STANDARD
RESIDENTIAL METER LOCATION

BY RAS
DATE 3-12-03 SMTR-1
REV. _____ SHEET 2 OF 2

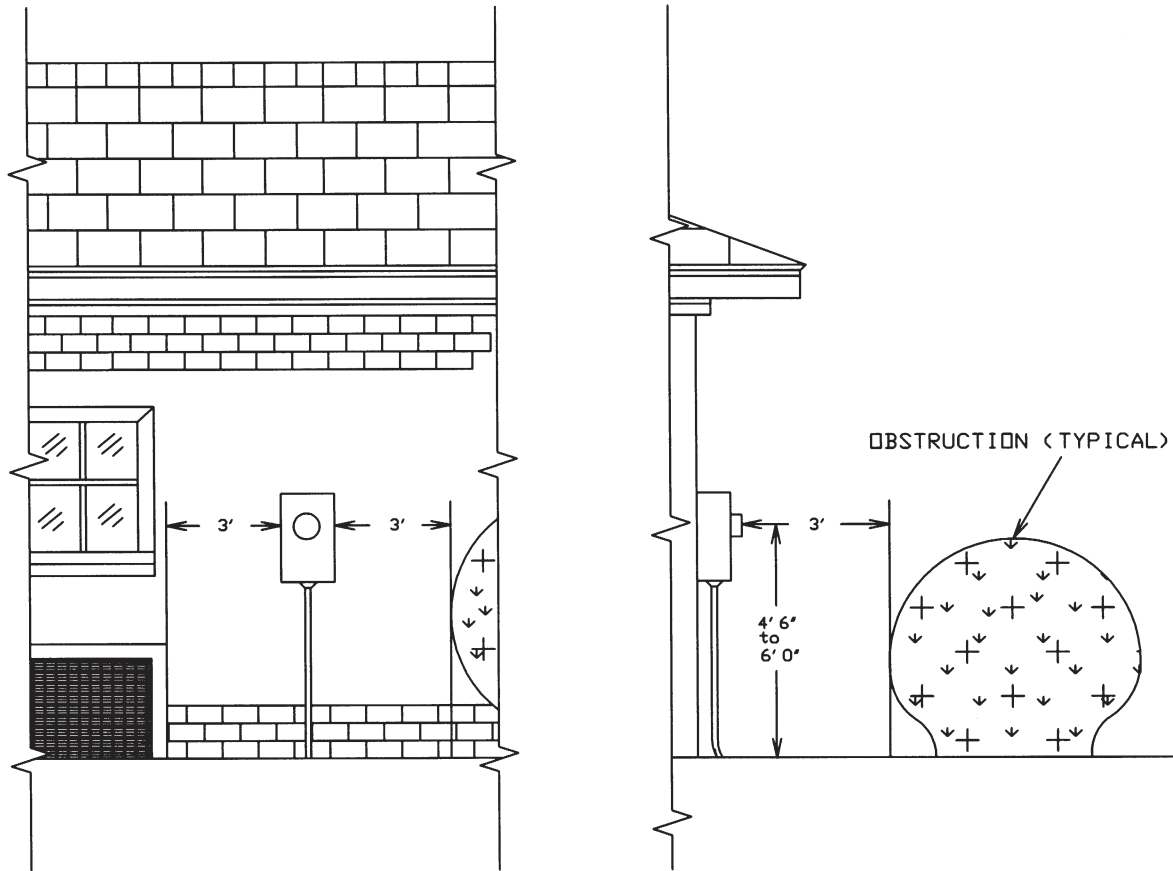

NOTES:

1. NO OBSTRUCTIONS ALLOWED, PERMANENT OR TEMPORARY, WITHIN 3' OF ELECTRIC METER IN ANY DIRECTION.
2. OBSTRUCTIONS INCLUDE, BUT NOT LIMITED TO, TREES, SHRUBS, HVAC UNITS OR BUILDINGS.
3. GAS METERS REQUIRE THE SAME CLEARANCE AS ELECTRIC METERS.
4. CUSTOMER MAY BE FINANCIALLY RESPONSIBLE FOR REMOVAL OF ANY OBSTRUCTION WHICH VIOLATES THIS REQUIREMENT.

DISTRIBUTION CONSTRUCTION STANDARD
SOUTH CAROLINA ELECTRIC & GAS CO.